







NOTE:			
LOCATION #1	LOCATION #2	LOCATION #3	LOCATION #4
VIOLATION - 160322 AWNING / CANOPIES / MARQUES	VIOLATION - 160323 CAMERAS	VIOLATION - 160324 FLAGPOLES / BANNERS	VIOLATION - 160325 AC / LOUVERS / GRILLES



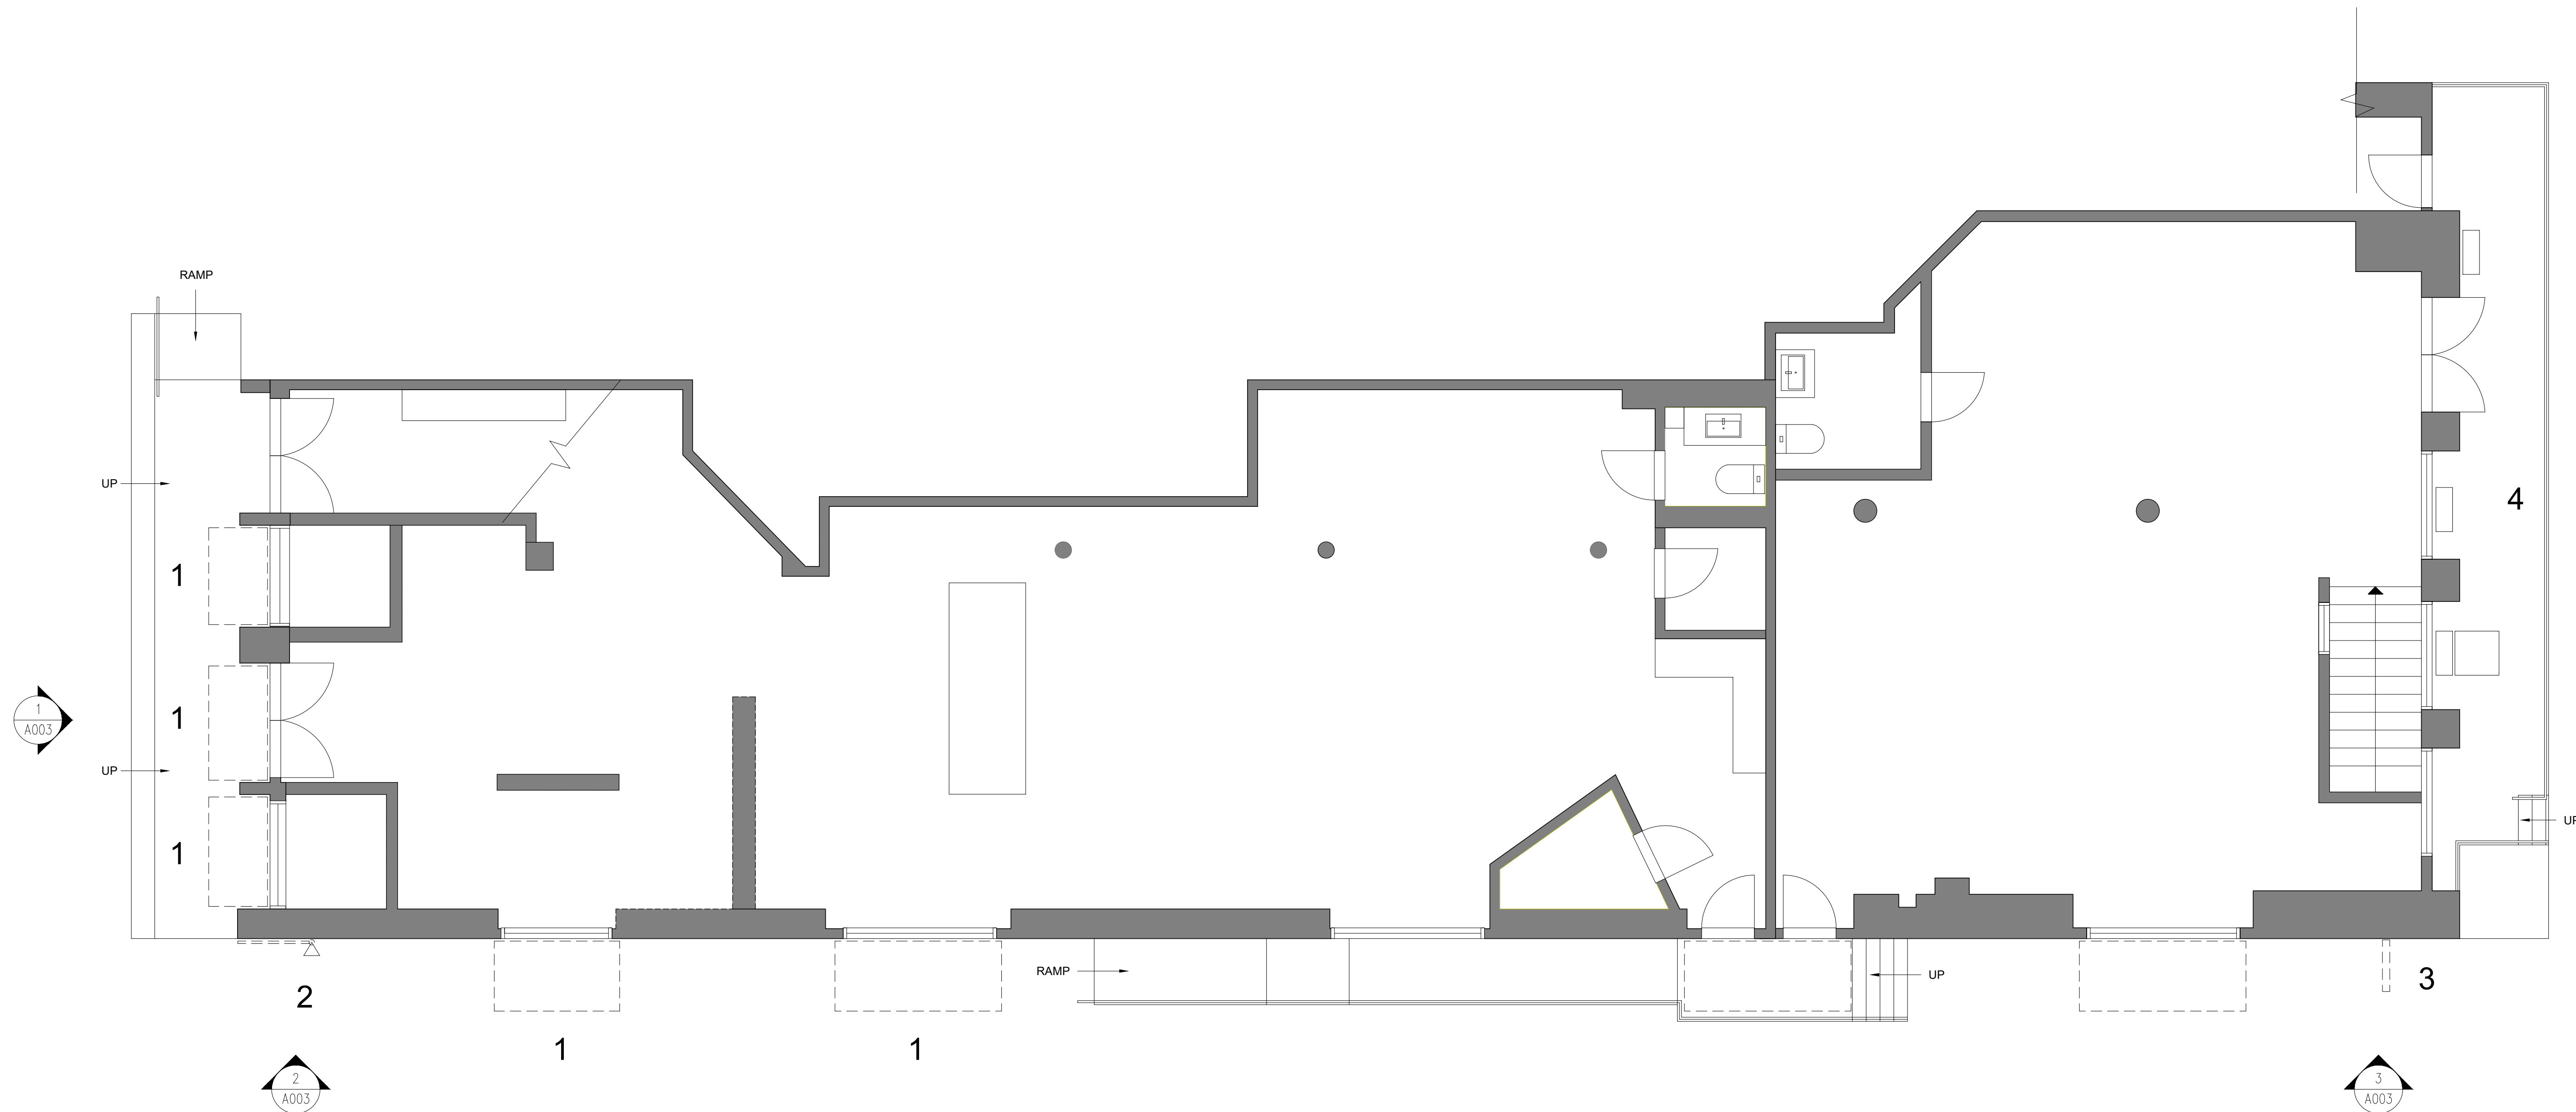

LOCATION #1	LOCATION #2	LOCATION #3	LOCATION #4
VIOLATION - 160322 AWNING / CANOPIES / MARQUES	VIOLATION - 160323 CAMERAS	VIOLATION - 160324 FLAGPOLES / BANNERS	VIOLATION - 160325 AC / LOUVERS / GRILLES
RESOLUTION: MAIN ENTRY AWNING REMOVED	RESOLUTION: CONDUIT & CAMERA REMOVED	RESOLUTION: EXTERIOR WALL BANNER REMOVED	RESOLUTION: AC UNIT RE-POSITIONED & MECHANICAL SCREEN INSTALLED.

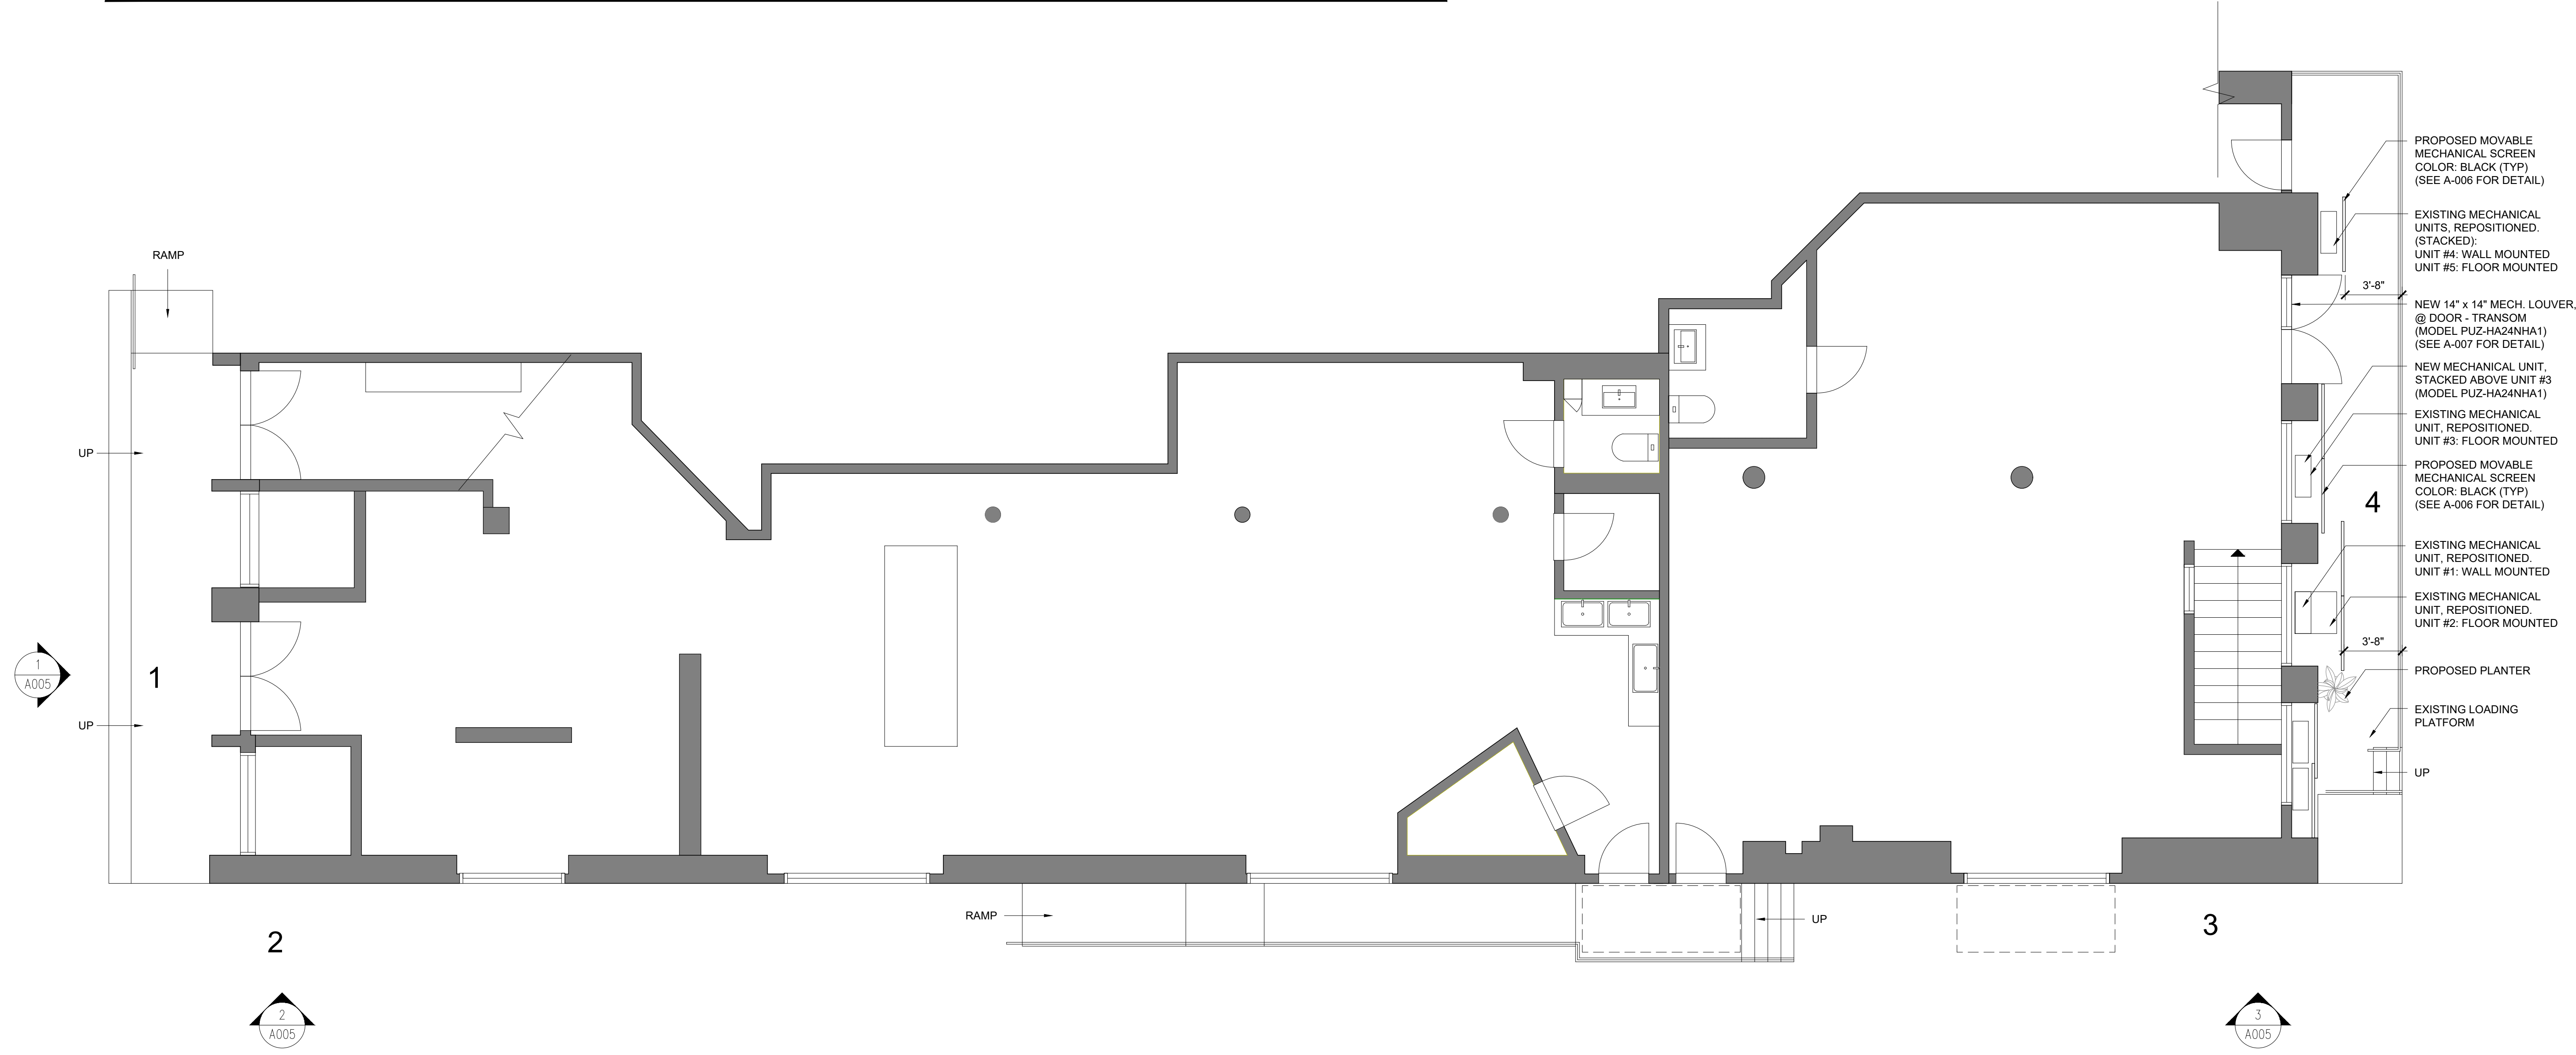

1  
A-002 EXTERIOR - PROPOSED CONDITIONS  
SCALE: N/A

19 BOND STREET

NEW YORK, NY, 10012

MEP ENGINEER  
NAME:  
ADDRESS:  
CITY:  
STATE:  
ZIP:  
TEL:  
E-MAIL:

STRUCTURAL ENGINEER  
NAME:  
ADDRESS:  
CITY:  
STATE:  
ZIP:  
TEL:  
E-MAIL:

SPECIAL INSPECTOR:  
NAME:  
ADDRESS:  
CITY:  
STATE:  
ZIP:  
TEL:  
E-MAIL:

REVISIONS:

DOB B-SCAN  
JOB #

DRAWING TITLE / INFORMATION:

EXISTING  
CONDITIONS  
REFERENCE  
PHOTOS

SEAL & SIGNATURE:



DATE: 01-30-2023  
DWG No.:

A-003.00

SHEET 04 OF 07



1 LOCATION #1 : VIOLATION - 160322

A-003 SCALE: N/A



2 LOCATION #2 : VIOLATION - 160323

A-003 SCALE: N/A




3 LOCATION #3 : VIOLATION - 160324

A-003 SCALE: N/A

AIR CONDITIONING UNITS SCHEDULE					
TYPE DESIGNATION	LOCATION	SERVICE	MANUFACTURER	MODEL	REMARKS
UNIT #1	OUTDOOR	COOLING/HEATING	LG	LSU240HLV	
UNIT #2	OUTDOOR	COOLING/HEATING	YORK	TCJD60S43S3A	
UNIT #3	OUTDOOR	COOLING/HEATING	FUJITSU	AOU24RLXQ	
UNIT #4	OUTDOOR	COOLING/HEATING	MITSUBISHI	PUMY-P60NKMU	
UNIT #5	OUTDOOR	COOLING/HEATING	MITSUBISHI	PUMY-P60NKMU	



1 LOCATION #4 : VIOLATION - 160325  
A-004 SCALE: N/A

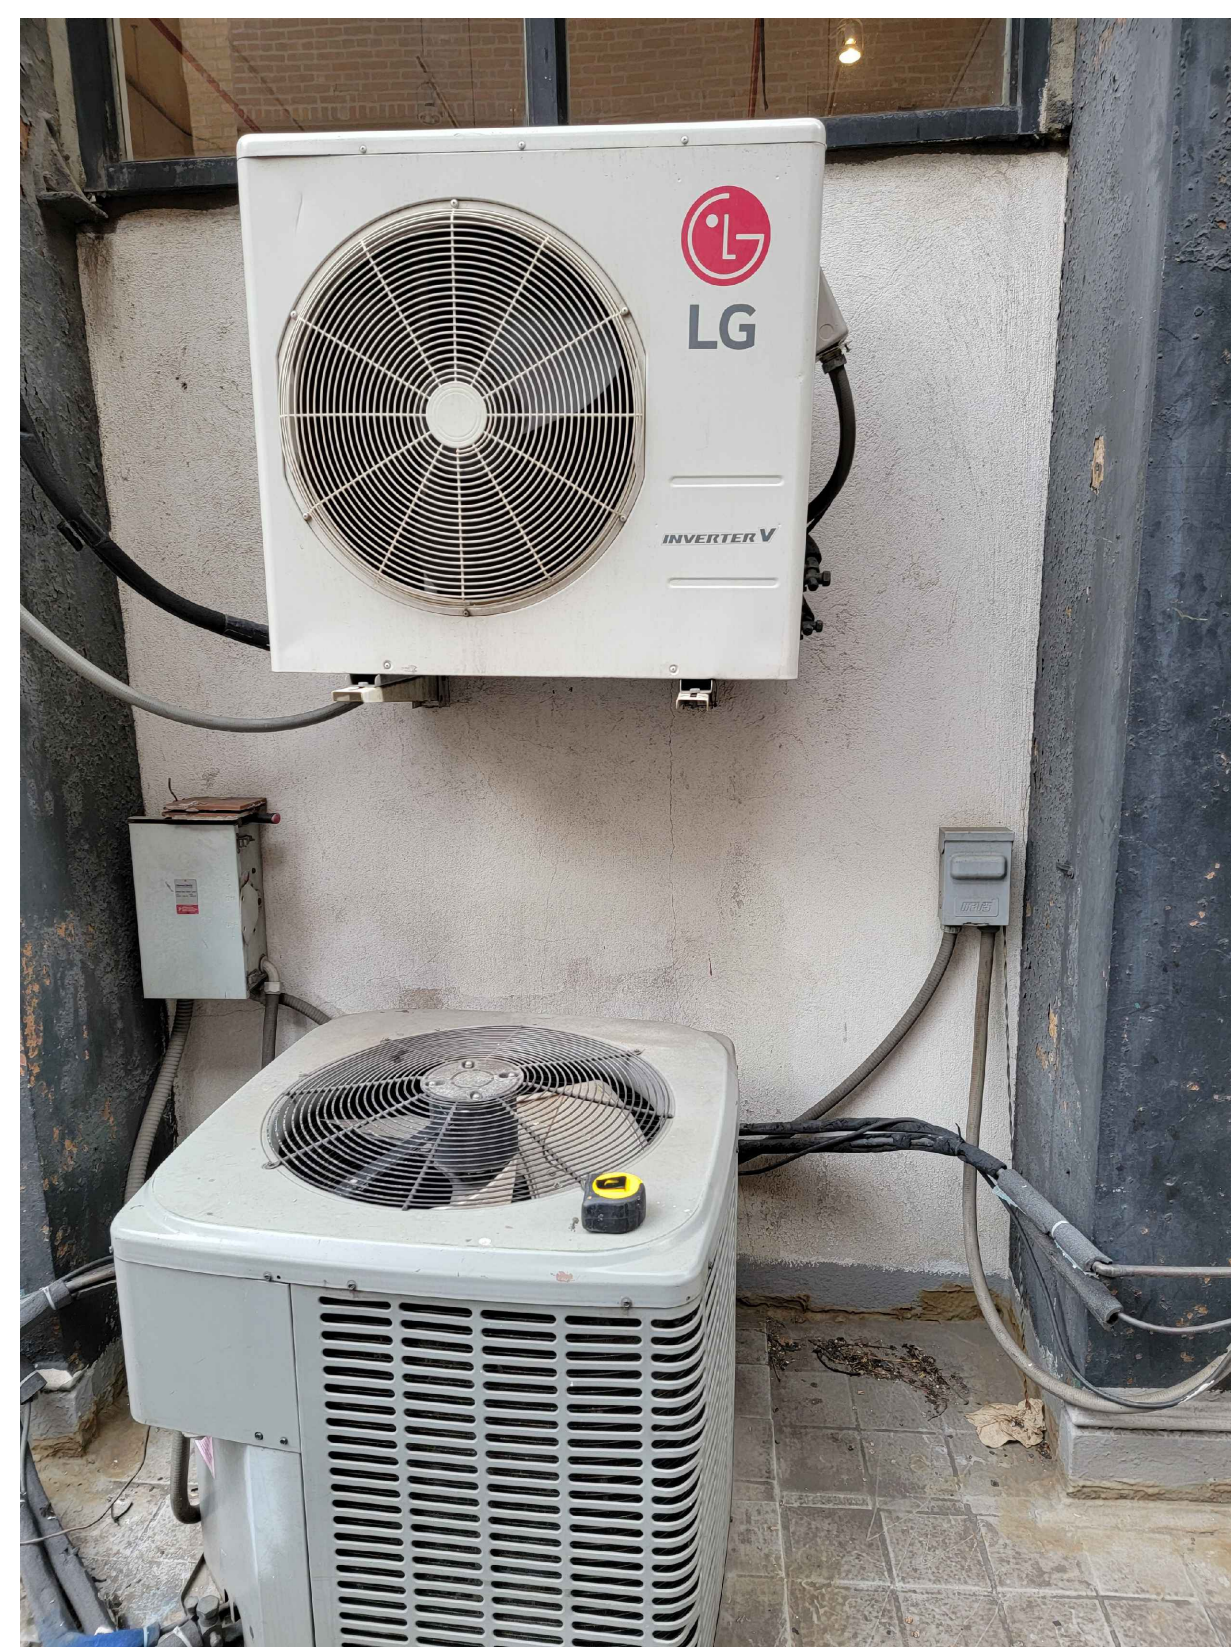

2 MECHANICAL EQUIPMENT #1 & #2  
A-004 SCALE: N/A



3 MECHANICAL EQUIPMENT #3  
A-004 SCALE: N/A



4 MECHANICAL EQUIPMENT #4 & #5  
A-004 SCALE: N/A

DOB B-SCAN  
JOB #

DRAWING TITLE / INFORMATION:

EXISTING  
CONDITIONS  
REFERENCE  
PHOTOS

SEAL & SIGNATURE:



DATE: 01-30-2023  
DWG No.:

A-004.00

SHEET 05 OF 07




3 LOCATION #2 : VIOLATION - 160323 REMOVED  
A-005 SCALE: N/A



4 LOCATION #3 : VIOLATION - 160324 REMOVED  
A-005 SCALE: N/A



2 LOCATION #1 : VIOLATION - 160322 REMOVED  
A-005 SCALE: N/A

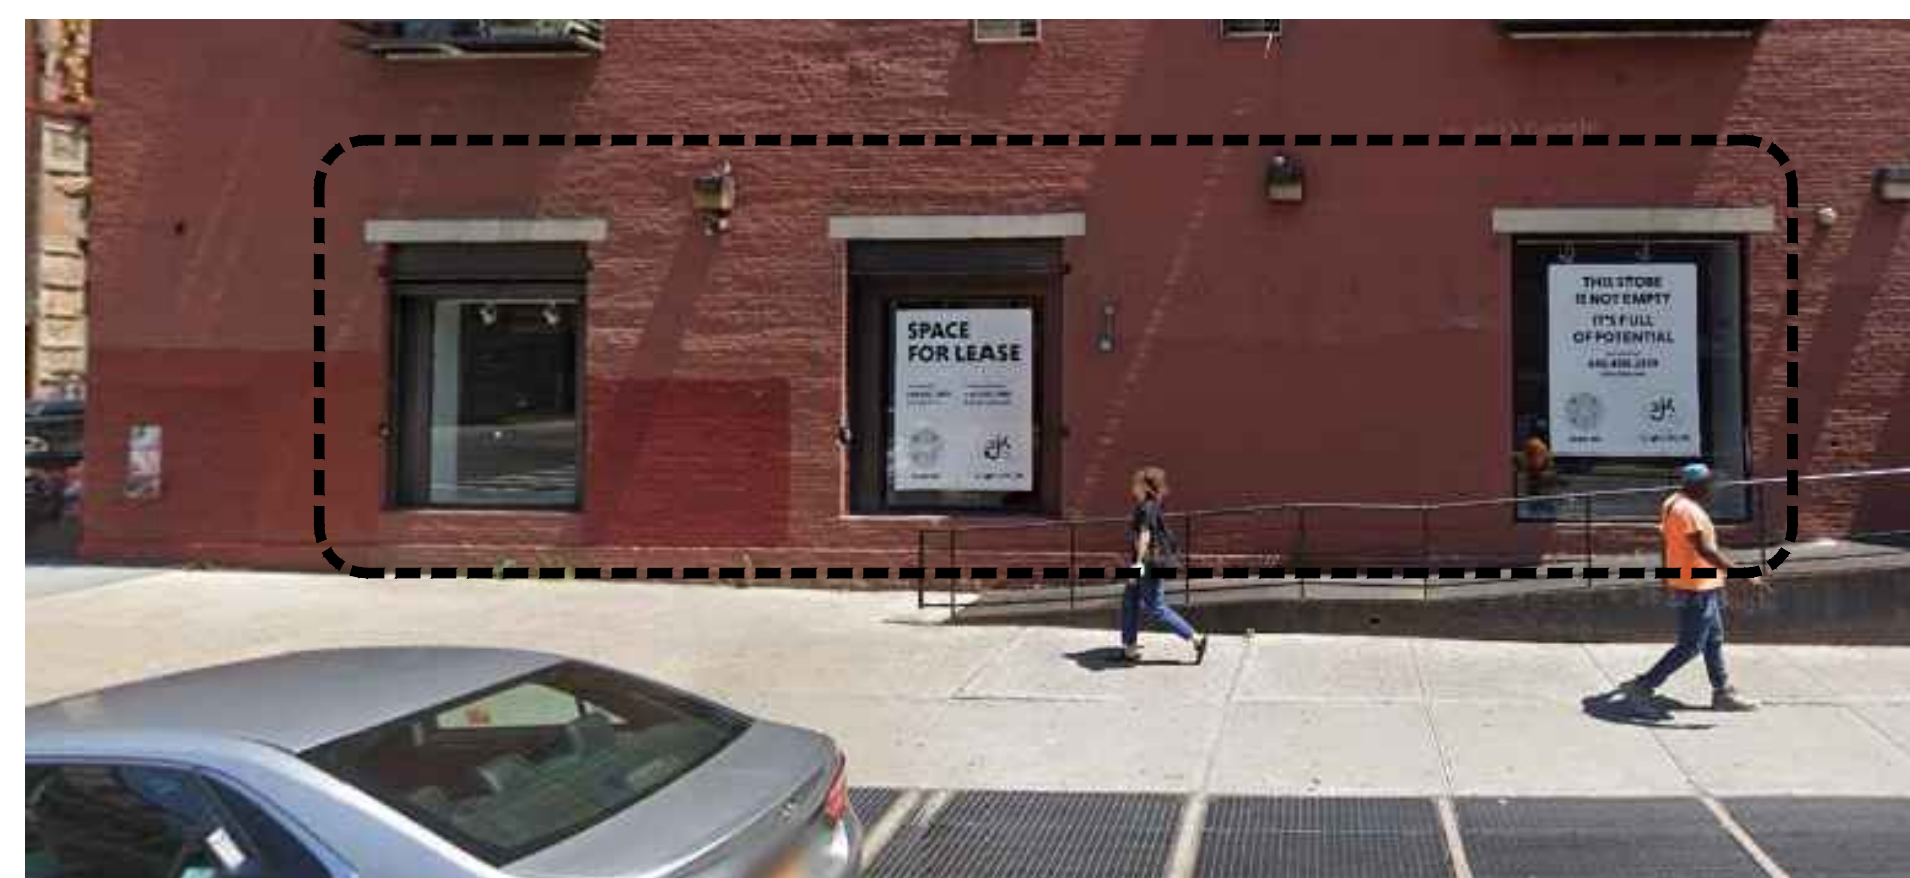

1 LOCATION #1 : VIOLATION - 160322 REMOVED  
A-005 SCALE: N/A




1 MOVABLE LOUVER WALL SCREEN : FRONT VIEW  
A-006 SCALE: N/A



2 MOVABLE LOUVER WALL SCREEN : SIDE VIEW  
A-006 SCALE: N/A



<b>Frame</b>	Heavy gauge extruded 6063-T5 aluminum, 4 in. (102 mm) x 0.081 in. (2 mm) nominal wall thickness
<b>Blades</b>	Drainable design, heavy gauge extruded 6063-T5 aluminum, 0.081 in. (2 mm) nominal wall thickness, positioned 37° and 45° on approximately 4 in. (102 mm) centers
<b>Louver Depth</b>	4 in. (102 mm)
<b>Construction</b>	Mechanically fastened
<b>Finish</b>	Mill
<b>Minimum Size</b>	12 in. W x 12 in. H (305 mm W x 305 mm H)
<b>Maximum Single Section Size</b>	120 in. W x 120 in. H (3048 mm W x 3048 mm H) Limited to 70 ft. sq. (6.5 sq. m)
<b>Wind Load</b>	25 PSF (1.2 kPa)

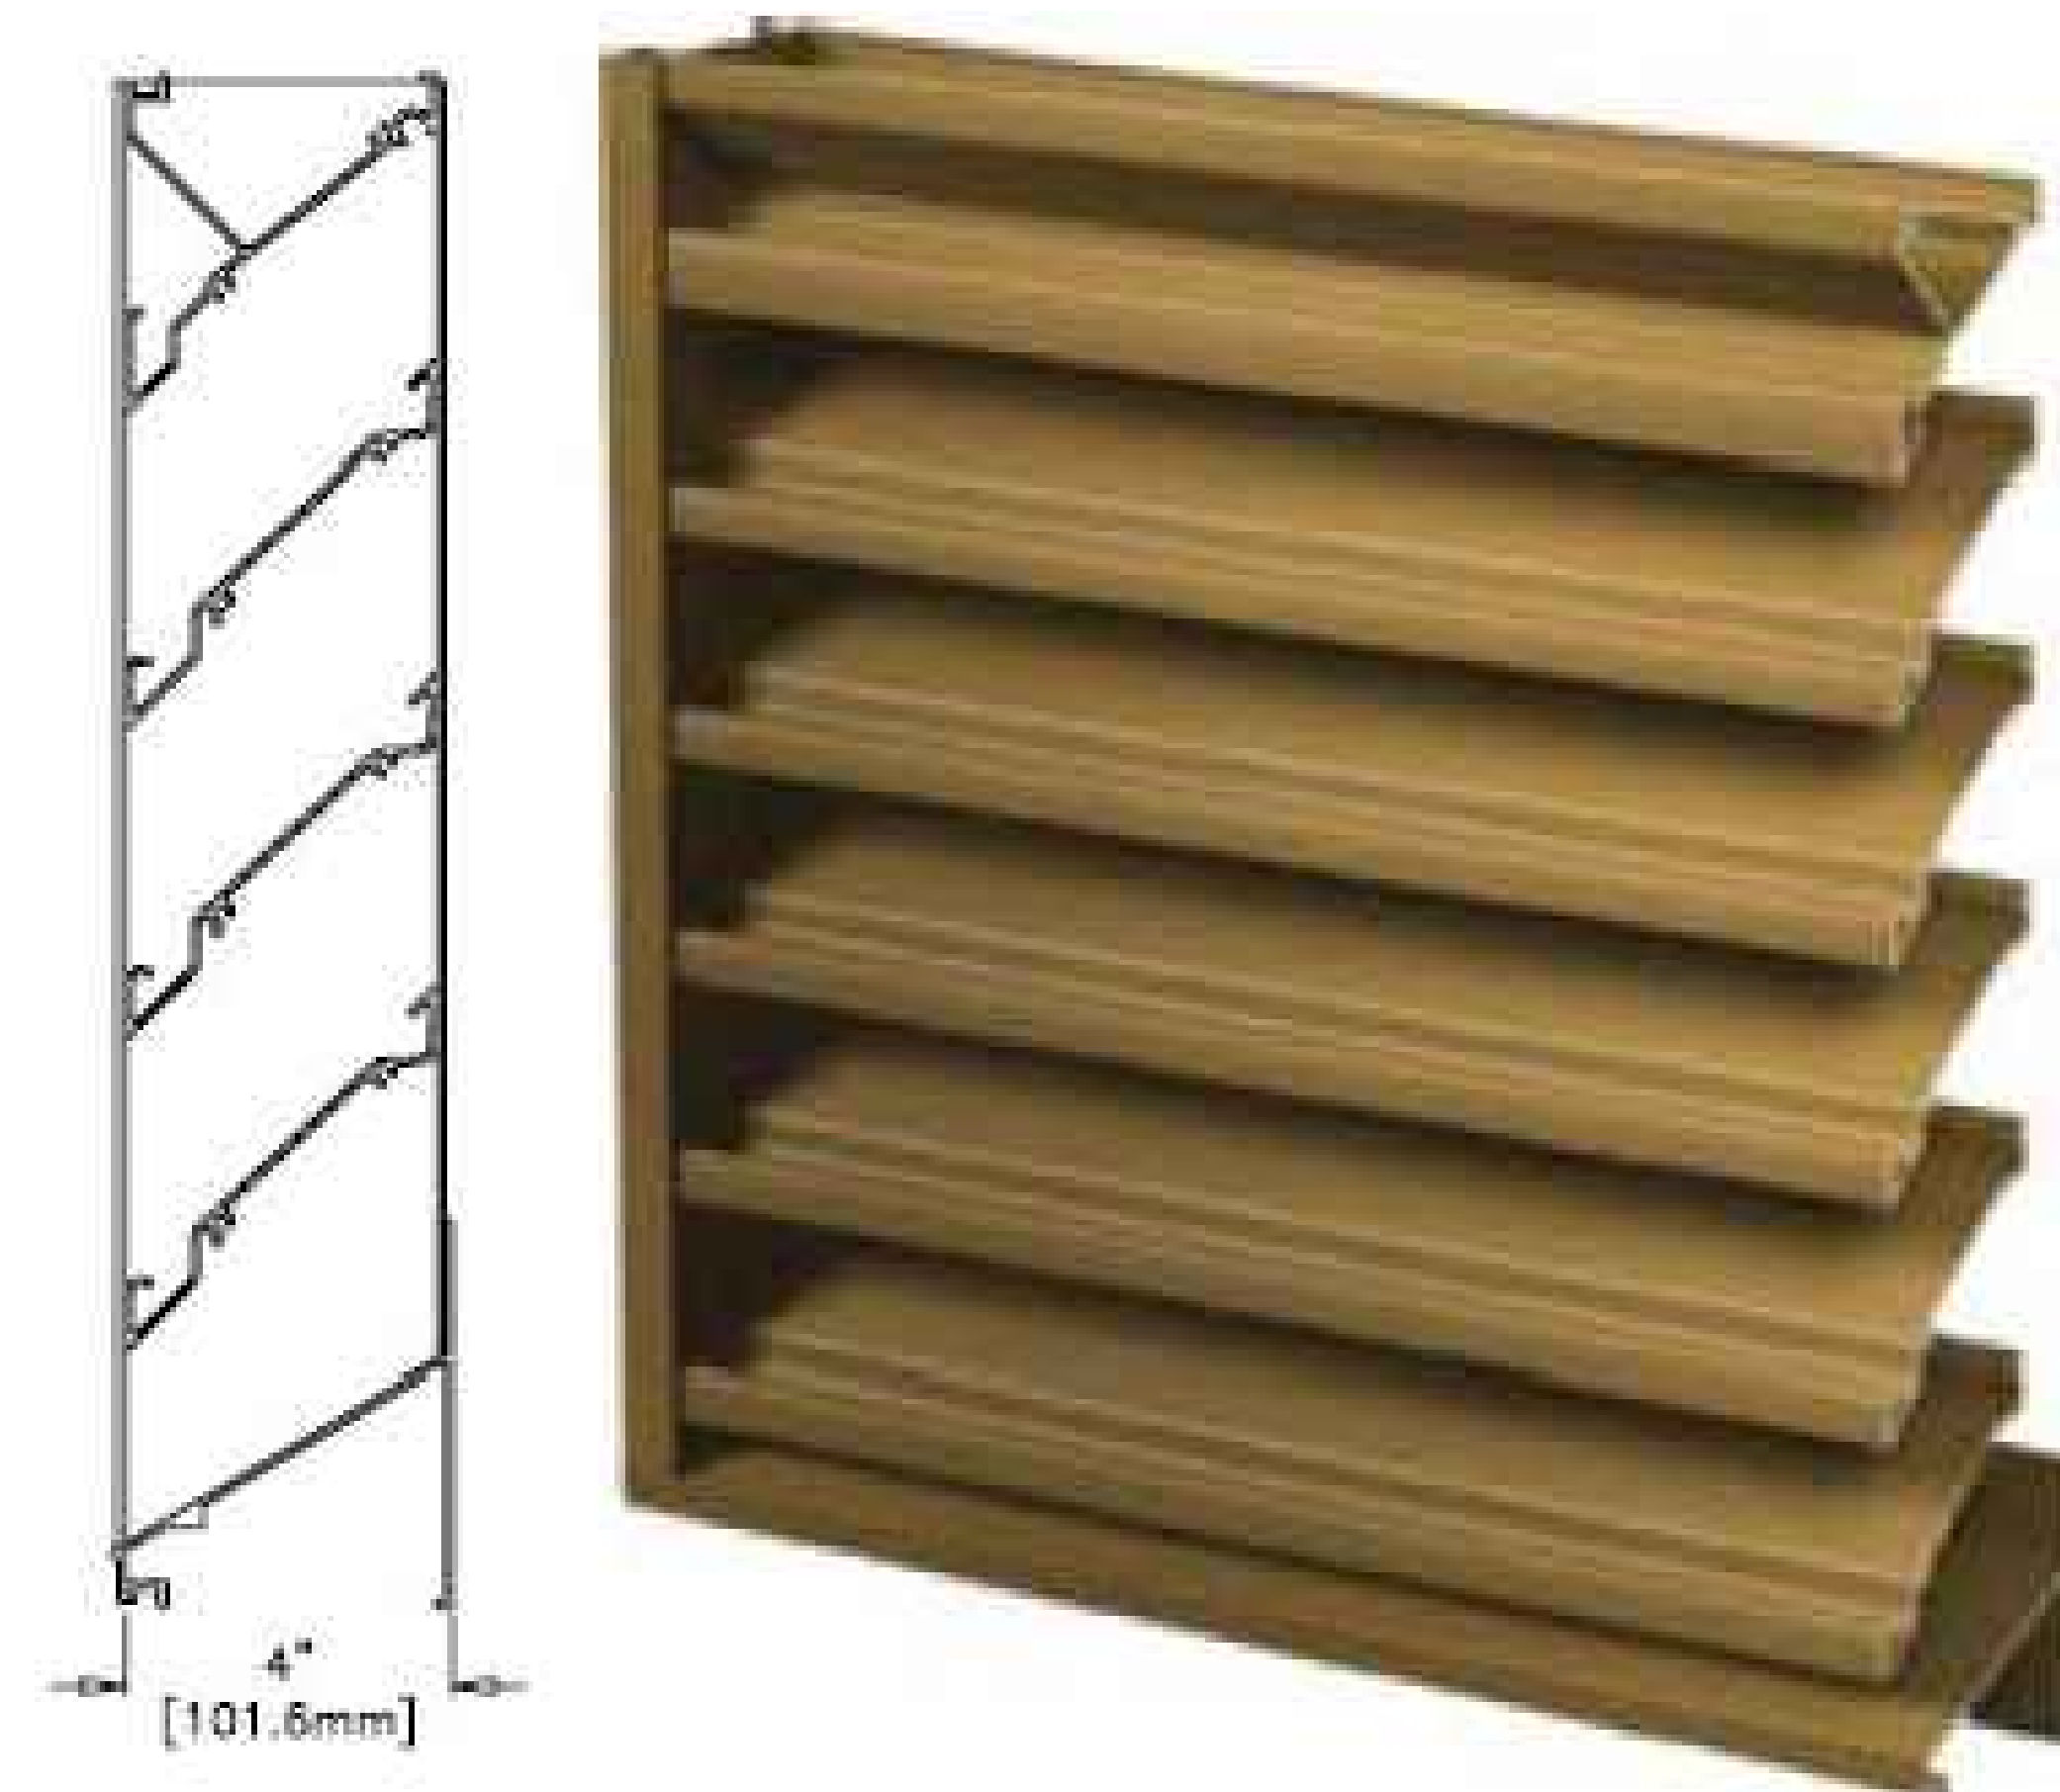

1 NEW MECHANICAL LOUVER  
A-007 SCALE: N/A